LUCAS COUNTY OFFICE OF MANAGEMENT AND BUDGET

One Government Center, Suite 800
Toledo, Ohio 43604

ADDENDUM NO. 2 DATE: October 7, 2013

To the Specifications
For
Interior Painting Project for the Lucas County Corrections Center
1622 Spielbusch Avenue
Toledo, Ohio 43604

THIS ADDENDUM MUST BE RECEIPTED FOR ON THE BID FORM:

This Addendum supplements and amends the original Project Specifications and shall be taken into account in preparing proposals, and shall become a part of the contract documents.

NOTE: Each Prime Contractor is responsible for notifying subcontractors of any addenda issued.

ITEM NO. 1 - 2nd FLOOR MEDICAL AREA HALLWAY
Add to the painting requirement the U-shaped hallway at cells one through ten on the 2nd floor as shown and noted to be added during the Pre-Bid meeting, and also shaded red on the attached sketch.

ITEM NO. 2 – MODULE AND CELL NUMBERING/LETTERING
All existing module and cell numbers and letters will be replaced with new numbers and letters.

ITEM NO. 3 – PROJECT DURATION CLARIFICATION
The total performance period for this work is 540 calendar days.

ITEM NO. 4 – 6th FLOOR COLOR
The walls on the 6th floor will be the lighter color only, the specified Pittsburgh Paints "Sleep Baby Sleep."

ITEM NO. 5 – 2 NORTH CLARIFICATION
The 2 North Module will have the two color scheme with the darker color used for the stripe. The non-ceramic areas in the resident restroom are included in the scope of work. The office and private restroom in this module are not included in the scope of work.

ITEM NO.6 – 2 EAST CLARIFICATION
The ceiling in the 2 East Module is not to be painted.

ITEM NO.7 – FLOOR PLANS
Sketch quality floor plans of floors two through six are attached. The areas to be painted are highlighted in yellow, and the added area is highlighted in red.

ITEM NO. 8 - MANDATORY PRE-BID SIGN-IN SHEET ATTACHED.

END OF ADDENDUM

LUCAS COUNTY

PRE-BID MEETING SIGN IN SHEET for the
Corrections Center 1622 Spielbusch
Interior Painting Project, Toledo, Ohio
Tuesday, October 1, 2013

	NAME	COMPANY	MAILING ADDRESS	PHONE	FAX
1	Andy Schacht	Conte Construction	912 Summit St. Tol. OH	419-241-3254	419-241-3425
		e-mail: andyschacht@conteconstruction.com		Cell 419-392-7444	
2	Costas Goutsias	KASTRA ~~[illegible]~~ LLC	1400 COTTONWOOD DR.		
		e-mail: KASTRA@LIVE.COM	LEWIS CENTER OHIO 43035	614-419-3326	
3	MATT HARTMAN	AFI		419-842-0444	
		e-mail:			
4	Dean Schiavone	deanschiavone@installfloors.net	305 Morris St Toledo Ohio	567-249-9945	419 842-1555
		e-mail:			
5	Doug Podiak	LCFD			
		e-mail: DPODIAK@CO.LUCAS.OH.US		419-213-6424	
6	John Potts	LCFD			
		e-mail:			
7	Tom Dodds	LC OMB			
		e-mail: TDODDS@CO.LUCAS.OH.US		419-213-4641	
8					
		e-mail:			
9					
		e-mail:			
10					
		e-mail:			
11					
		e-mail:			
12					
		e-mail:			

LUCAS COUNTY

PRE-BID MEETING SIGN IN SHEET for the
Corrections Center 1622 Spielbusch
Interior Painting Project, Toledo, Ohio
Tuesday, October 1, 2013

13	BEN SKINNER	MID MICHIGAN PAINTING e-mail: benskinner@midmichiganpainting.com		Cell 810 423 3479
14	JAMES KATSINIS	ATLAS Painting & Sheeting CORP. e-mail: frangos@atlas-painting.com		(716) 564-0490
15	CHRIS PLOSKUNAK	THOMARIOS e-mail: CPLOSKUNAK@THOMARIOS.COM		330 670 9900
16	Dave Friodell	DFriodell@co.lucas.oh.us e-mail:		419-213-4398
17	JOHN SYLVESTER	JSYLVESTER@CO.LUCAS.OH.US e-mail:		419 213-4950
18	Todd Reed	TReed@co.lucas.oh.gov e-mail:		419-213-4398
19	Milan Vogka	MVOGKA@CO.LUCAS.OH.US e-mail:		419-213-4904
20	GARY JOHNSON	gary johnson@installfloors.net e-mail:	AFI	(419) 450-0714
21		e-mail:		
22		e-mail:		
23		e-mail:		
24		e-mail:		
25		e-mail:		

GENERAL NOTES:

1. CAMERA LOCATIONS ARE SHOWN APPROXIMATE. FINAL LOCATIONS SHALL BE DETERMINED IN THE FIELD THROUGH COORDINATION WITH THE OWNER.
2. CONDUIT PATHWAYS ARE SHOWN IN SIMPLIFIED STRAIGHT LINE CONFIGURATIONS FOR CLARITY. ACTUAL LOCATION AND CONFIGURATION SHALL BE DETERMINED IN THE FIELD BY CONTRACTOR. WHERE EXPOSED, RUN ALL CONDUIT ON UNDERSIDE OF STRUCTURAL DECK ABOVE LAY-IN CEILING (WHERE OCCURS), TIGHT TO WALLS WHEREVER POSSIBLE. ALL EXPOSED PATHWAYS SHALL BE APPROVED BY OWNER PRIOR TO INSTALLATION. DISMANTLE, SALVAGE, REINSTALL AND REPAIR/REPLACE WITH MATCHING, LIKE KIND CEILING SYSTEM MATERIALS TO RESTORE TO PRE-PROJECT CONDITION.
3. ALL CONDUIT TO BE 3/4" IMC NOMINAL, UNLESS OTHERWISE NOTED.
4. ⟨T⟩ REFERS TO DEDUCT ALTERNATE ITEM. REFER TO "T" DRAWINGS & SPECIFICATION SECTION 012300 FOR ADDITIONAL INFORMATION.

CODED NOTES:

1. LOCATION FOR SECURITY MONITORING & CAMERA CONTROL EQUIPMENT. SEE ENLARGED PLANS.
2. REMOTE MONITORING WORK STATION. SUPPLY W/ DATA JACK @ 18" AFF. SUPPLIES VIA CONCEALED CONDUIT IN WALL CONSTRUCTION (WHERE DRYWALL) OR SURFACE WIRE MOLD (WHERE CONCRETE OR MASONRY WALL) TO ABOVE CEILING.
3. PC CABINET IN CONTROL ROOM. SEE ENLARGED PLANS ON DRAWING E-12.
4. SYSTEMS MED STORAGE ROOM 2028: OWNER WILL REMOVE PROPERTY AS REASONABLY REQUIRED FOR CONTRACTOR TO PERFORM THE WORK. CONTRACTOR SHALL SAFEGUARD REMAINING CONTENTS FROM CONSTRUCTION DEBRIS. CLEAN ALL DEBRIS, CLEAN AND WASH DOWN ALL DUST-LADEN SURFACE, AND RETURN ROOM TO PRE-PROJECT CONDITION AS SOON AS POSSIBLE.
5. PANIC ALARM BUTTON INSTALLED BENEATH COUNTERIN ROOMS 2001, 2010 AND 2020. WIRING IN CONDUIT TO 2 CONTROL RO FLOOR BELOW & MAIN CONTROL.
6. CCTV CAMERA SIGNAL AND CONTROL WIRING PULLBOX (24"Hx20"Wx8"D) LABELED "MDF2" AND VERTICAL CONDUIT RISER FOR NEW SECURITY CAMERA SYSTEM. REFER TO DRAWING T-11 AND SECTION 282000 FOR ADDITIONAL INFORMATION.

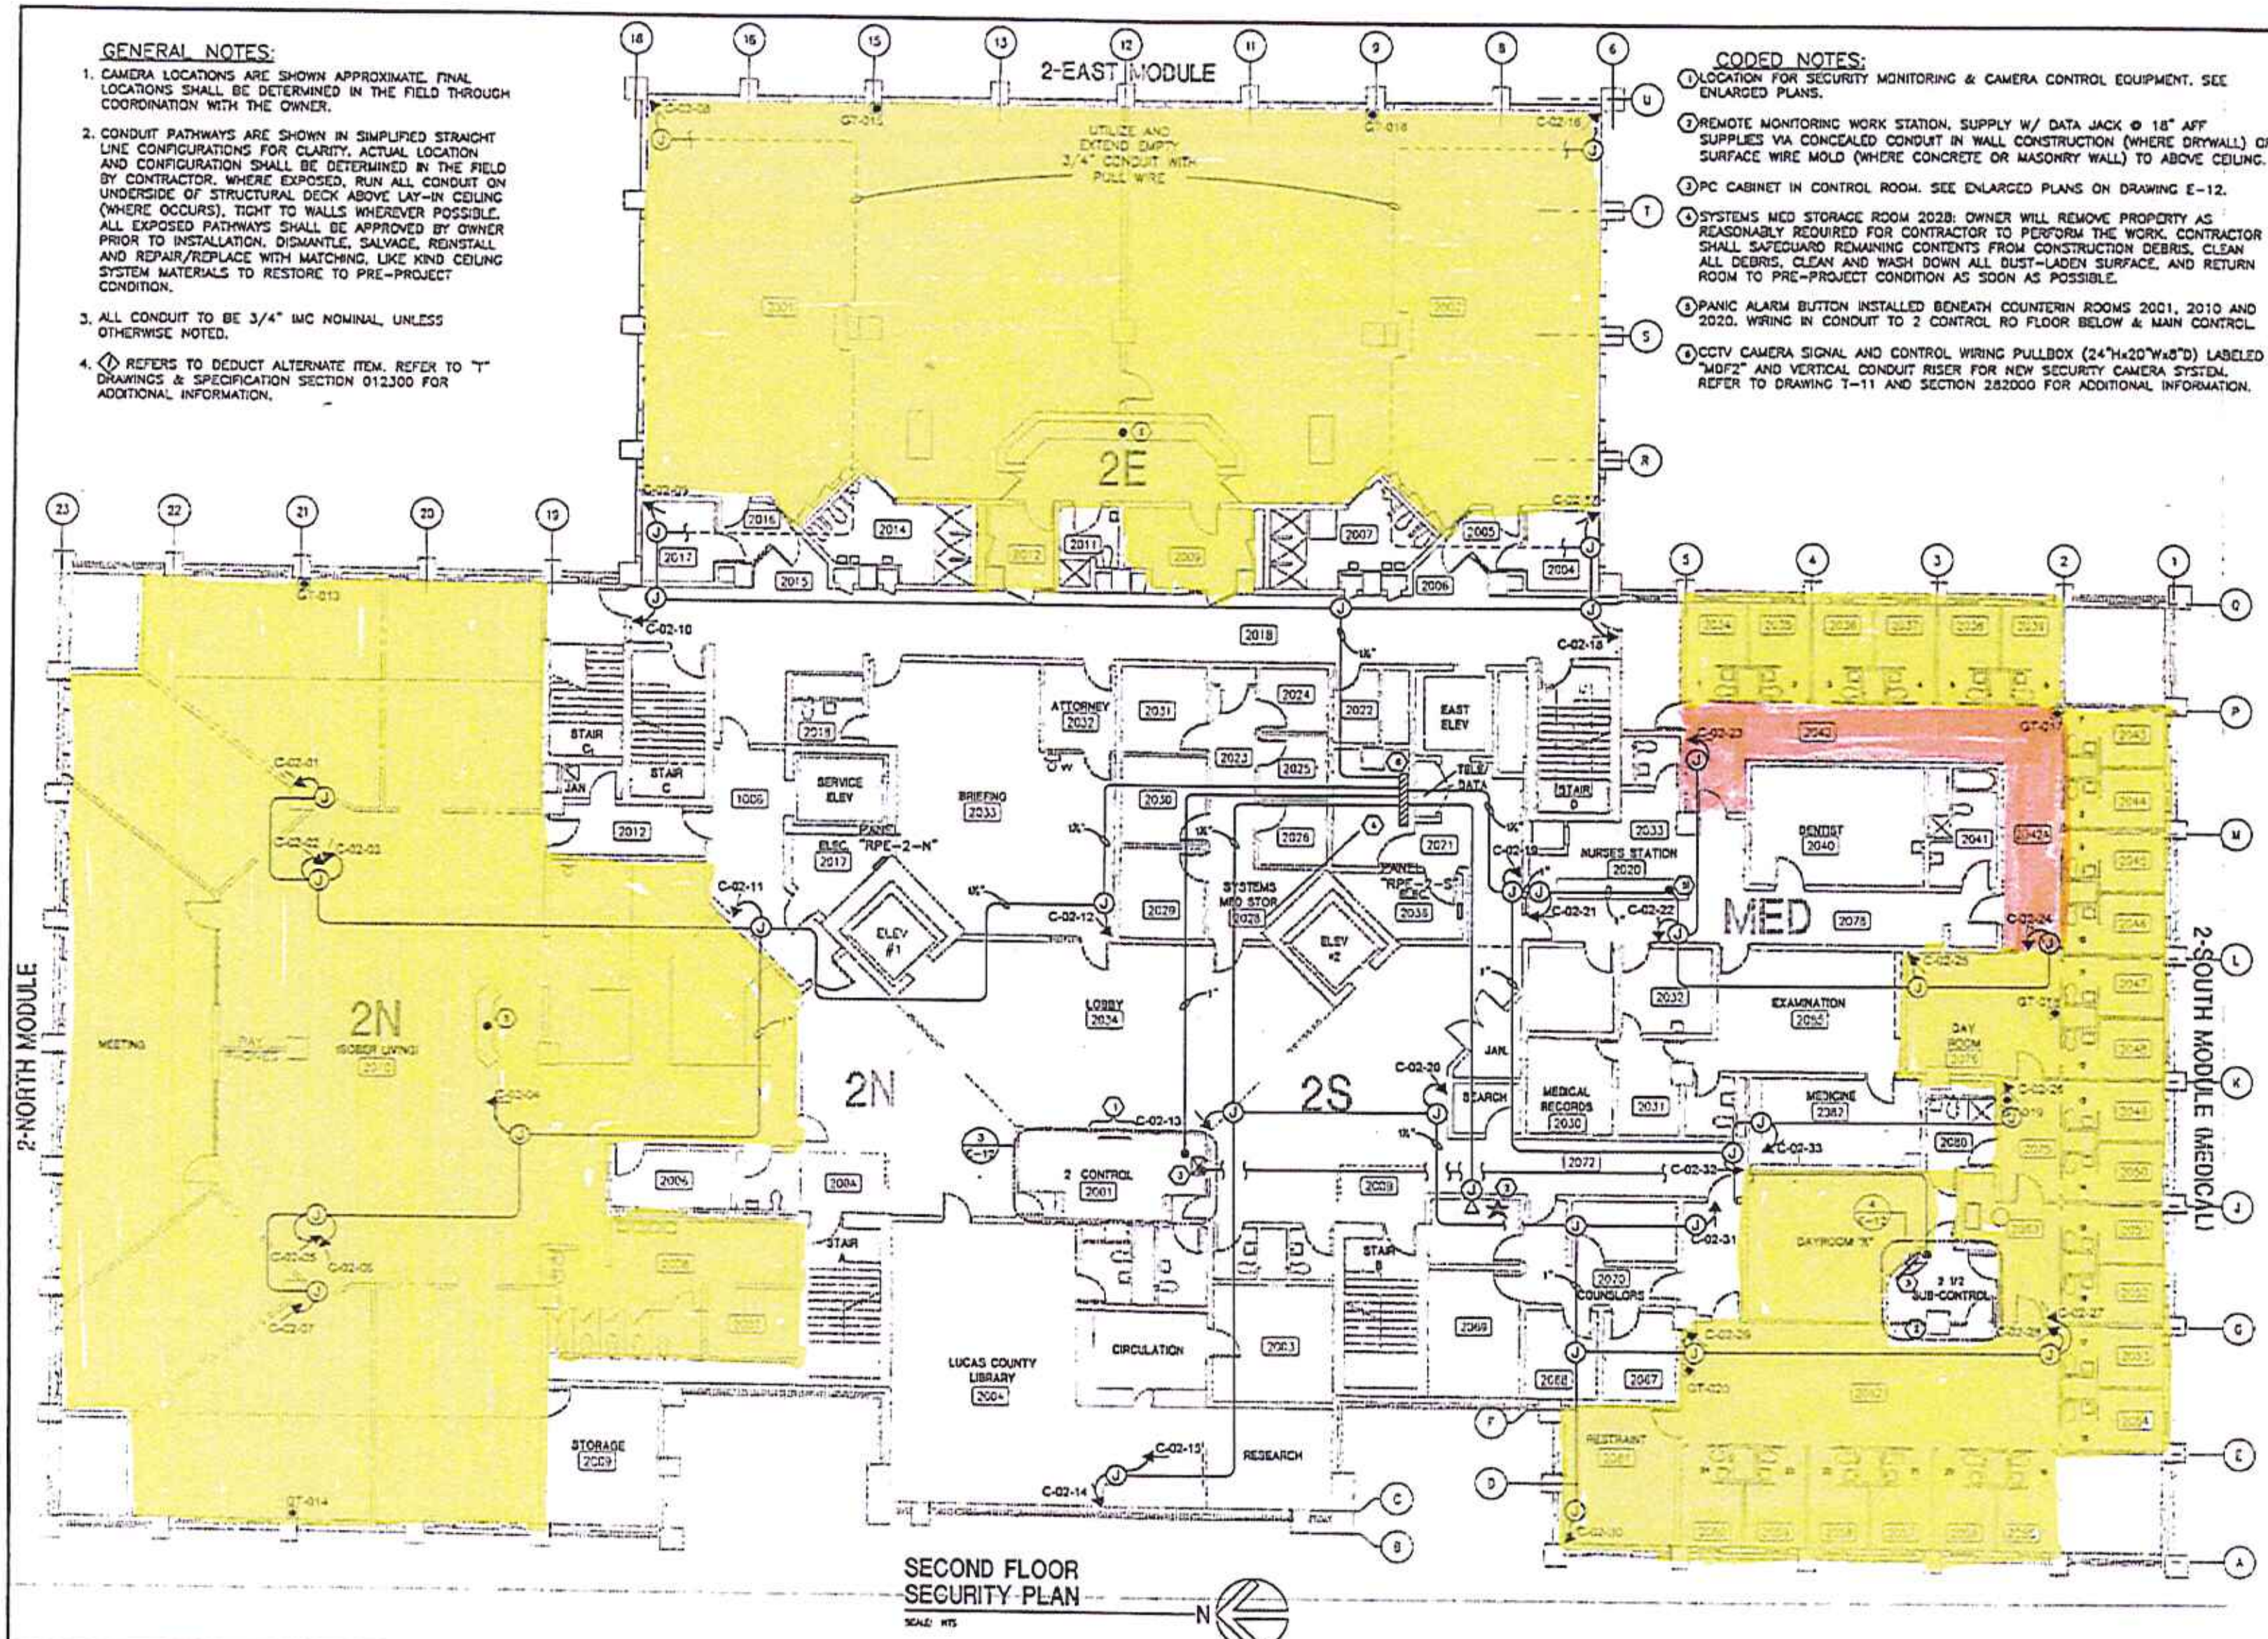

SECOND FLOOR SECURITY PLAN

SCALE: NTS

DLZ

614 WEST SUPERIOR AVENUE, SUITE 1000
CLEVELAND, OHIO 44113

BID SUBMITTAL

PROJECT NUMBER 0622-7008-00

DATE: 12/1/2008

LUCAS COUNTY CORRECTIONS CENTER
SECURITY SYSTEM PROJECT

ELECTRICAL
SECOND FLOOR PLAN

SHEET 7 OF 32

DRAWING NUMBER E-6

GENERAL NOTES:

1. CAMERA LOCATIONS ARE SHOWN APPROXIMATE. FINAL LOCATIONS SHALL BE DETERMINED IN THE FIELD THROUGH COORDINATION WITH THE OWNER.
2. CONDUIT PATHWAYS ARE SHOWN IN SIMPLIFIED STRAIGHT LINE CONFIGURATIONS FOR CLARITY. ACTUAL LOCATION AND CONFIGURATION SHALL BE DETERMINED IN THE FIELD BY CONTRACTOR. WHERE EXPOSED, RUN ALL CONDUIT ON UNDERSIDE OF STRUCTURAL DECK ABOVE LAY-IN CEILING (WHERE OCCURS), TIGHT TO WALLS WHEREVER POSSIBLE. ALL EXPOSED PATHWAYS SHALL BE APPROVED BY OWNER PRIOR TO INSTALLATION. DISMANTLE, SALVAGE, REINSTALL AND REPAIR/REPLACE WITH MATCHING, LIKE KIND CEILING SYSTEM MATERIALS TO RESTORE TO PRE-PROJECT CONDITION.
3. ALL CONDUIT TO BE 3/4" IMC NOMINAL, UNLESS OTHERWISE NOTED.
4. ◇ REFERS TO DEDUCT ALTERNATE ITEM. REFER TO "T" DRAWINGS & SPECIFICATION SECTION 012300 FOR ADDITIONAL INFORMATION.

CODED NOTES:

1. LOCATION FOR SECURITY MONITORING & CAMERA CONTROL EQUIPMENT. SEE ENLARGED PLANS.
2. REMOTE MONITORING WORK STATION. SUPPLY W/ DATA JACK @ 18" AFF SUPPLIES VIA CONCEALED CONDUIT IN WALL CONSTRUCTION (WHERE DRYWALL) OR SURFACE WIRE MOLD (WHERE CONCRETE OR MASONRY WALL) TO ABOVE CEILING.
3. PC CABINET IN CONTROL ROOM. SEE ENLARGED PLANS ON DRAWING E-12.
4. INTERCOM EQUIPMENT ROOM 3070: OWNER WILL REMOVE PROPERTY AS REASONABLY REQUIRED FOR CONTRACTOR TO PERFORM THE WORK. CONTRACTOR SHALL SAFEGUARD REMAINING CONTENTS FROM CONSTRUCTION DEBRIS, CLEAN ALL DEBRIS, CLEAN AND WASH DOWN ALL DUST-LADEN SURFACE, AND RETURN ROOM TO PRE-PROJECT CONDITION AS SOON AS POSSIBLE.
5. CCTV CAMERA SIGNAL AND CONTROL WIRING PULLBOX (24"Hx20"Wx8"D) LABELED "MDF3" AND VERTICAL CONDUIT RISER FOR NEW SECURITY CAMERA SYSTEM. REFER TO DRAWING T-11 AND SECTION 282000 FOR ADDITIONAL INFORMATION.

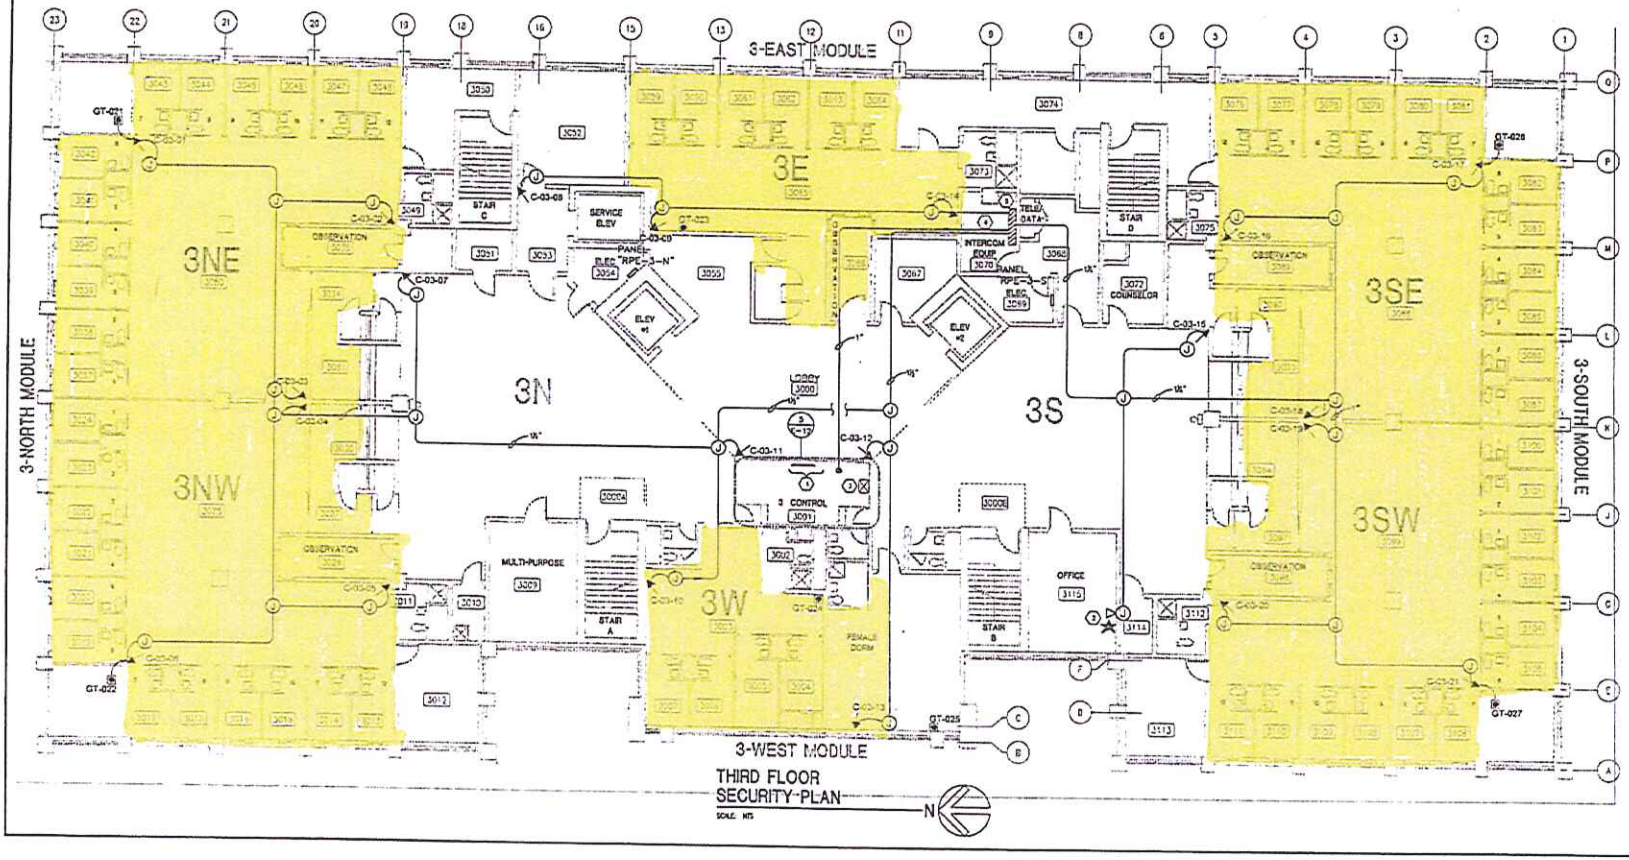

THIRD FLOOR SECURITY PLAN

SCALE: NTS

DLZ
614 WEST SUPERIOR AVENUE, SUITE 1000
CLEVELAND, OHIO 44113

BID SUBMITTAL

PROJECT NUMBER 0622-7008-00

LUCAS COUNTY CORRECTIONS CENTER
SECURITY SYSTEM PROJECT

ELECTRICAL
THIRD FLOOR PLAN

SHEET 8 OF 32

DRAWING NUMBER E-7

GENERAL NOTES:

1. CAMERA LOCATIONS ARE SHOWN APPROXIMATE. FINAL LOCATIONS SHALL BE DETERMINED IN THE FIELD THROUGH COORDINATION WITH THE OWNER.
2. CONDUIT PATHWAYS ARE SHOWN IN SIMPLIFIED STRAIGHT LINE CONFIGURATIONS FOR CLARITY. ACTUAL LOCATION AND CONFIGURATION SHALL BE DETERMINED IN THE FIELD BY CONTRACTOR. WHERE EXPOSED, RUN ALL CONDUIT ON UNDERSIDE OF STRUCTURAL DECK ABOVE LAY-IN CEILING (WHERE OCCURS), TIGHT TO WALLS WHEREVER POSSIBLE. ALL EXPOSED PATHWAYS SHALL BE APPROVED BY OWNER PRIOR TO INSTALLATION. DISMANTLE, SALVAGE, REINSTALL AND REPAIR/REPLACE WITH MATCHING, LIKE KIND CEILING SYSTEM MATERIALS TO RESTORE TO PRE-PROJECT CONDITION.
3. ALL CONDUIT TO BE 3/4" IMC NOMINAL, UNLESS OTHERWISE NOTED.
4. ◇ REFERS TO DEDUCT ALTERNATE ITEM. REFER TO "T" DRAWINGS & SPECIFICATION SECTION 012300 FOR ADDITIONAL INFORMATION.

CODED NOTES:

1. LOCATION FOR SECURITY MONITORING & CAMERA CONTROL EQUIPMENT. SEE ENLARGED PLANS.
2. REMOTE MONITORING WORK STATION. SUPPLY W/ DATA JACK @ 18" AFF SUPPLIES VIA CONCEALED CONDUIT IN WALL CONSTRUCTION (WHERE DRYWALL) OR SURFACE WIRE MOLD (WHERE CONCRETE OR MASONRY WALL) TO ABOVE CEILING.
3. PC CABINET IN CONTROL ROOM. SEE ENLARGED PLANS ON DRAWING E-12.
4. SYSTEMS ROOM 4070: OWNER WILL REMOVE PROPERTY AS REASONABLY REQUIRED FOR CONTRACTOR TO PERFORM THE WORK. CONTRACTOR SHALL SAFEGUARD REMAINING CONTENTS FROM CONSTRUCTION DEBRIS, CLEAN ALL DEBRIS, CLEAN AND WASH DOWN ALL DUST-LADEN SURFACE, AND RETURN ROOM TO PRE-PROJECT CONDITION AS SOON AS POSSIBLE.
5. CCTV CAMERA SIGNAL AND CONTROL WIRING PULLBOX (24"Hx20"Wx8"D) LABELED "MDF4" AND VERTICAL CONDUIT RISER FOR NEW SECURITY CAMERA SYSTEM. REFER TO DRAWING T-11 AND SECTION 282000 FOR ADDITIONAL INFORMATION.

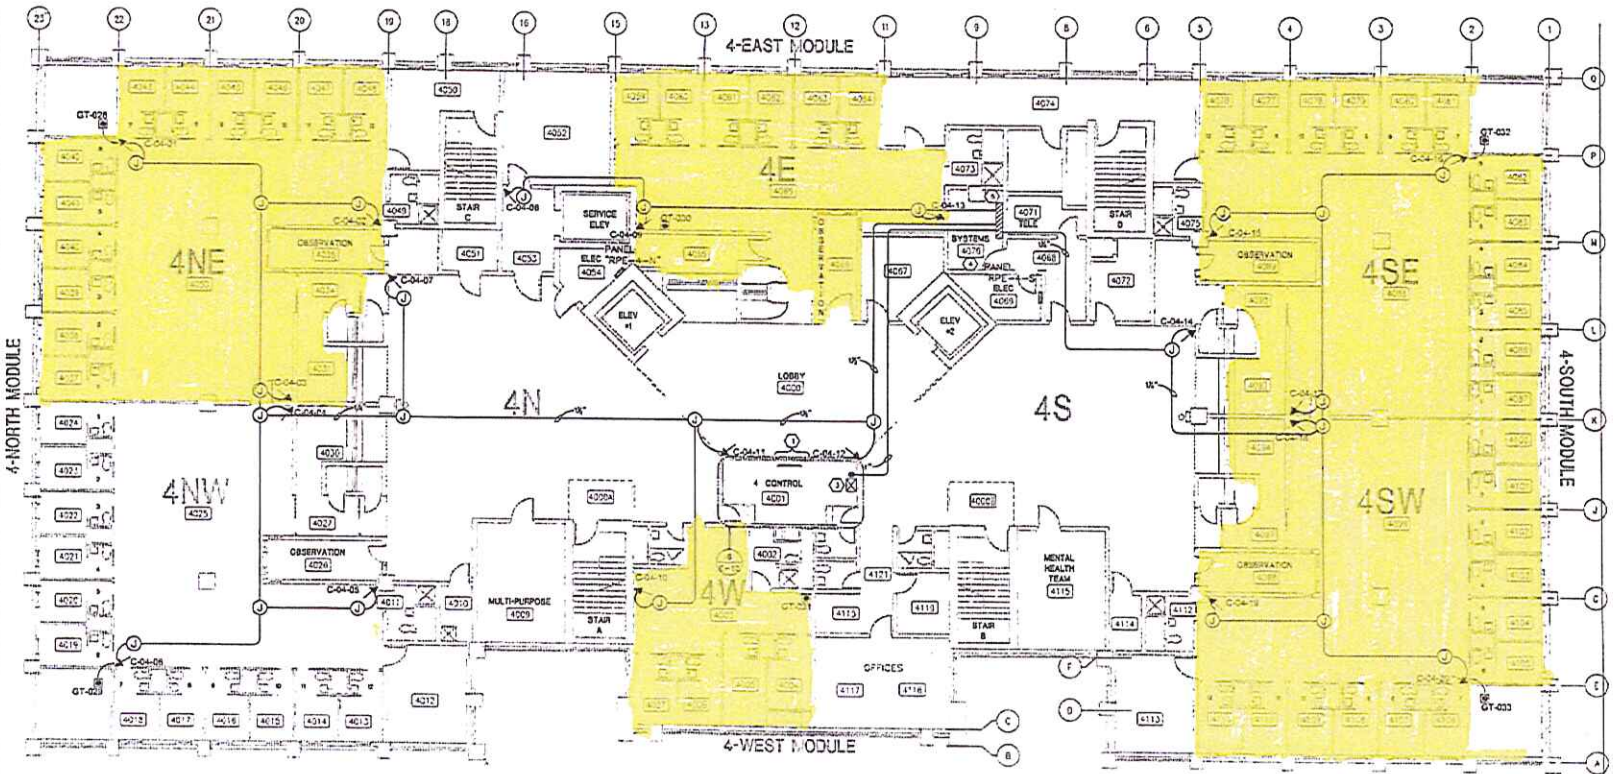

FOURTH FLOOR SECURITY PLAN

SCALE: NTS

N

DLZ

614 WEST SUPERIOR AVENUE, SUITE 1000
CLEVELAND, OHIO 44113

BID SUBMITTAL

DRAWN BY	DATE
DESIGNED BY	DATE 11/14/2008
CHKD.	APPD.
SCALE:	
PROJECT NUMBER	0622-7008-00

LUCAS COUNTY CORRECTIONS CENTER
SECURITY SYSTEM PROJECT

ELECTRICAL
FOURTH FLOOR PLAN

SHEET 9
OF 32

DRAWING NUMBER
E-8

GENERAL NOTES:

1. CAMERA LOCATIONS ARE SHOWN APPROXIMATE. FINAL LOCATIONS SHALL BE DETERMINED IN THE FIELD THROUGH COORDINATION WITH THE OWNER.
2. CONDUIT PATHWAYS ARE SHOWN IN SIMPLIFIED STRAIGHT LINE CONFIGURATIONS FOR CLARITY. ACTUAL LOCATION AND CONFIGURATION SHALL BE DETERMINED IN THE FIELD BY CONTRACTOR. WHERE EXPOSED, RUN ALL CONDUIT ON UNDERSIDE OF STRUCTURAL DECK ABOVE LAY-IN CEILING (WHERE OCCURS). TIGHT TO WALLS WHEREVER POSSIBLE. ALL EXPOSED PATHWAYS SHALL BE APPROVED BY OWNER PRIOR TO INSTALLATION. DISMANTLE, SALVAGE, REINSTALL AND REPAIR/REPLACE WITH MATCHING, LIKE KIND CEILING SYSTEM MATERIALS TO RESTORE TO PRE-PROJECT CONDITION.
3. ALL CONDUIT TO BE 3/4" IMC NOMINAL, UNLESS OTHERWISE NOTED.
4. ⟨D⟩ REFERS TO DEDUCT ALTERNATE ITEM. REFER TO "T" DRAWINGS & SPECIFICATION SECTION 012300 FOR ADDITIONAL INFORMATION.

CODED NOTES:

(1) LOCATION FOR SECURITY MONITORING & CAMERA CONTROL EQUIPMENT. SEE ENLARGED PLANS.

(2) REMOTE MONITORING WORK STATION. SUPPLY W/ DATA JACK @ 18" AFF SUPPLIES VIA CONCEALED CONDUIT IN WALL CONSTRUCTION (WHERE DRYWALL) OR SURFACE WIRE MOLD (WHERE CONCRETE OR MASONRY WALL) TO ABOVE CEILING.

(3) PC CABINET IN CONTROL ROOM. SEE ENLARGED PLANS ON DRAWING E-12.

(4) SYSTEMS/VA ROOM 5061: OWNER WILL REMOVE PROPERTY AS REASONABLY REQUIRED FOR CONTRACTOR TO PERFORM THE WORK. CONTRACTOR SHALL SAFEGUARD REMAINING CONTENTS FROM CONSTRUCTION DEBRIS, CLEAN ALL DEBRIS, CLEAN AND WASH DOWN ALL DUST-LADEN SURFACE, AND RETURN ROOM TO PRE-PROJECT CONDITION AS SOON AS POSSIBLE.

(5) CCTV CAMERA SIGNAL AND CONTROL WIRING PULLBOX (24"Hx20"Wx6"D) LABELED "MDF3" AND VERTICAL CONDUIT RISER FOR NEW SECURITY CAMERA SYSTEM. REFER TO DRAWING T-11 AND SECTION 282000 FOR ADDITIONAL INFORMATION.

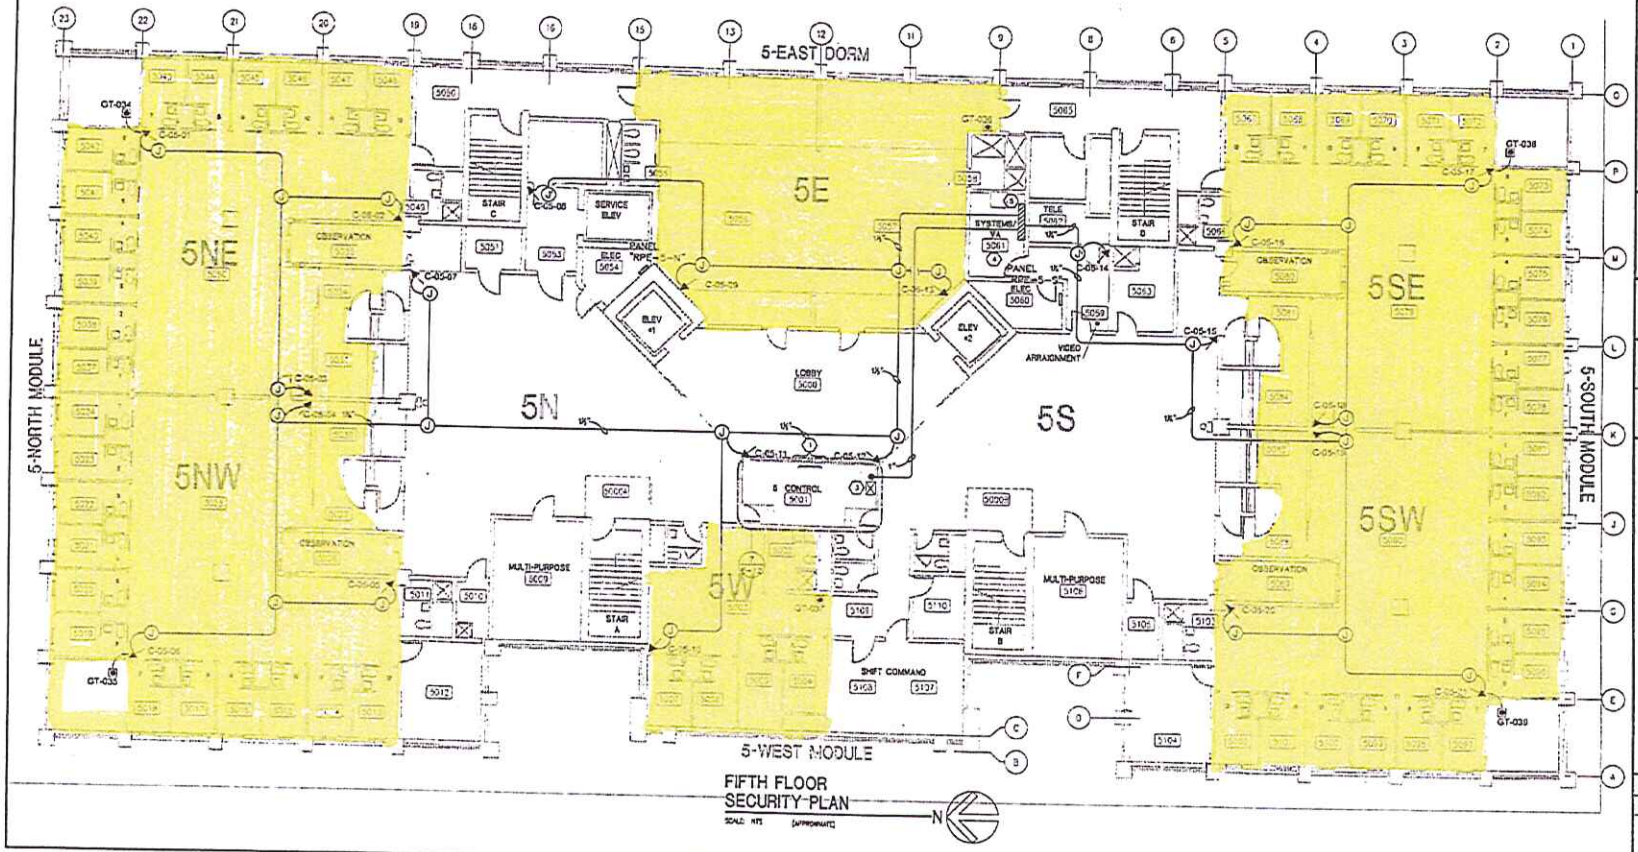

FIFTH FLOOR SECURITY PLAN

SCALE: NTS (APPROXIMATE)

N

DLZ
614 WEST SUPERIOR AVENUE, SUITE 1000
CLEVELAND, OHIO 44113

BID SUBMITTAL

DATE:	
REVISED:	
DATE: 11/5/2008	
SCALE:	
PROJECT NUMBER	0622-7008-00

LUCAS COUNTY CORRECTIONS CENTER
SECURITY SYSTEM PROJECT

ELECTRICAL
FIFTH FLOOR PLAN

SHEET 10 OF 32

DRAWING NUMBER
E-9

GENERAL NOTES:

1. CAMERA LOCATIONS ARE SHOWN APPROXIMATE. FINAL LOCATIONS SHALL BE DETERMINED IN THE FIELD THROUGH COORDINATION WITH THE OWNER.
2. CONDUIT PATHWAYS ARE SHOWN IN SIMPLIFIED STRAIGHT LINE CONFIGURATIONS FOR CLARITY. ACTUAL LOCATION AND CONFIGURATION SHALL BE DETERMINED IN THE FIELD BY CONTRACTOR. WHERE EXPOSED, RUN ALL CONDUIT ON UNDERSIDE OF STRUCTURAL DECK ABOVE LAY-IN CEILING (WHERE OCCURS), TIGHT TO WALLS WHEREVER POSSIBLE. ALL EXPOSED PATHWAYS SHALL BE APPROVED BY OWNER PRIOR TO INSTALLATION. DISMANTLE, SALVAGE, REINSTALL AND REPAIR/REPLACE WITH MATCHING, LIKE KIND CEILING SYSTEM MATERIALS TO RESTORE TO PRE-PROJECT CONDITION.
3. ALL CONDUIT TO BE 3/4" IMC NOMINAL, UNLESS OTHERWISE NOTED.
4. ◇ REFERS TO DEDUCT ALTERNATE ITEM. REFER TO "T" DRAWINGS & SPECIFICATION SECTION 012300 FOR ADDITIONAL INFORMATION.

CODED NOTES:

1. LOCATION FOR SECURITY MONITORING & CAMERA CONTROL EQUIPMENT. SEE ENLARGED PLANS.
2. REMOTE MONITORING WORK STATION. SUPPLY W/ DATA JACK @ 18" AFF SUPPLIES VIA CONCEALED CONDUIT IN WALL CONSTRUCTION (WHERE DRYWALL) OR SURFACE WIRE MOLD (WHERE CONCRETE OR MASONRY WALL) TO ABOVE CEILING.
3. PC CABINET IN CONTROL ROOM. SEE ENLARGED PLANS ON DRAWING E-12.
4. SYSTEM ROOM 6078: OWNER WILL REMOVE PROPERTY AS REASONABLY REQUIRED FOR CONTRACTOR TO PERFORM THE WORK. CONTRACTOR SHALL SAFEGUARD REMAINING CONTENTS FROM CONSTRUCTION DEBRIS, CLEAN ALL DEBRIS, CLEAN AND WASH DOWN ALL DUST-LADEN SURFACE, AND RETURN ROOM TO PRE-PROJECT CONDITION AS SOON AS POSSIBLE.
5. CCTV CAMERA SIGNAL AND CONTROL WIRING PULLBOX (24"Hx20"Wx8"D) LABELED "MDF6" AND VERTICAL CONDUIT RISER FOR NEW SECURITY CAMERA SYSTEM. REFER TO DRAWING T-11 AND SECTION 282000 FOR ADDITIONAL INFORMATION.

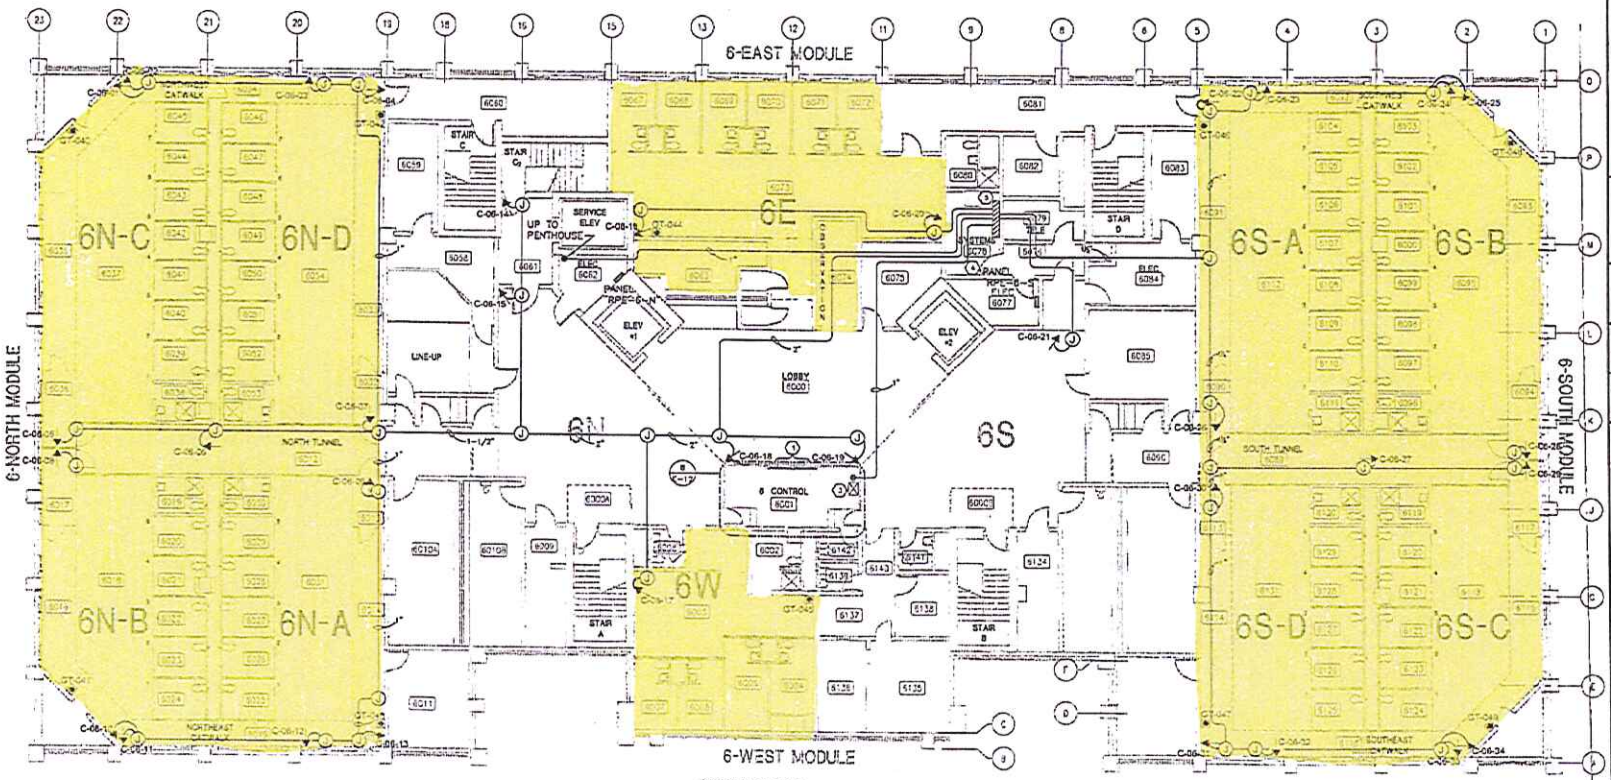

SIXTH FLOOR SECURITY PLAN

SCALE: NTS

N

DLZ
614 WEST SUPERIOR AVENUE, SUITE 1600
CLEVELAND, OHIO 44113

BID SUBMITTAL

0622-7008-00

LUCAS COUNTY CORRECTIONS CENTER
SECURITY SYSTEM PROJECT

ELECTRICAL
SIXTH FLOOR PLAN

SHEET 11
OF 32

DRAWING NUMBER
E-10